



RS-485 NETWORK:
Use 2x(4x) twisted pair (100-250ohm). Screen not required, but unused wire may be terminated as shield. Cables for Profibus, Interbus, Ethernet, CAN bus or standard RS-485 networks may be used.

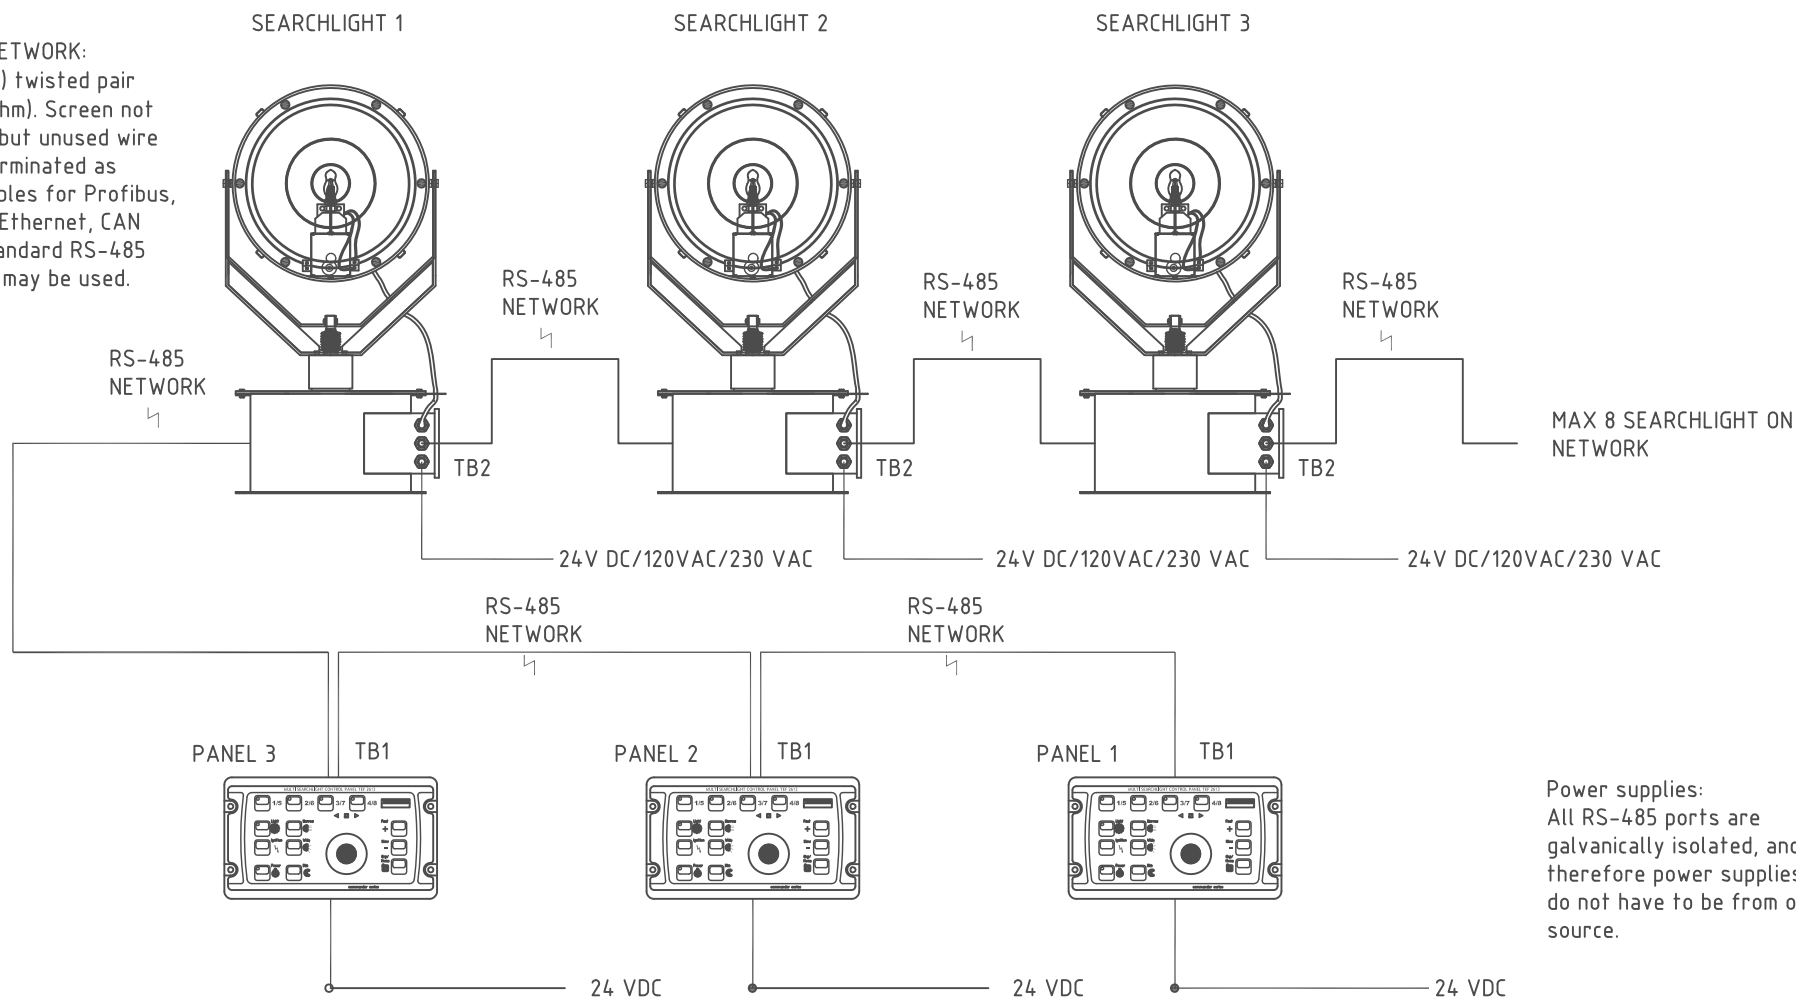

Power supplies:
All RS-485 ports are galvanically isolated, and therefore power supplies do not have to be from one source.

MAX. 8 PANELS ON NETWORK

NEW DESIGN	31.01.07	C.K.R.
	DATE	SIGN.
SYMBOL	REVISION	Gen. rough.
 Strandsvingen 6, P.O.Box 8003 N-4068 STAVANGER, NORWAY www.tranberg.com info@tranberg.com	Projection	Gen. toler.
	Drw. no. 600A102170 File nr. 600A102170 Subst. for Subst. by	Gen. toler.
		Rev. A
WIRING DIAGRAM TEF 2650 PRINCIPLE TERMINATION PLAN SHOWN FOR HALOGEN SEARCHLIGHTS	Page 1 of 1	Approvals
	Scale NONE	Cust.
	Date 07.02.06	Contr.
	Design C.K.R.	Appr.
© TRANBERG A.S 2006		